

**NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT PROCESS FOR THE PROPOSED SHONGWENI 2 x 500 MVA 400/132 kV SUBSTATION, APPROXIMATELY 40KM ESKOM HECTOR – SHONGWENI 400KV POWERLINE AND ASSOCIATED INFRASTRUCTURE WITHIN THE JURISDICTION OF ETHEKWINI METROPOLITAN MUNICIPALITY, WARDS 4 AND 103 IN THE KWAZULU NATAL PROVINCE
25 NOVEMBER 2016 - 23 JANUARY 2017**


Notice is hereby given in terms of Regulation 41 (2) of the Environmental Impact Assessment (EIA) Regulations of December 2014, published in terms of Chapter 5 of the National Environmental Management Act, 1998 (Act No. 107 of 1998) for the purpose of applying for Environmental Authorisation for the aforementioned activity.

NATURE OF ACTIVITY

Eskom Holdings SOC Limited proposes to develop the Shongweni 2 x 500 MVA 400/132 kV substation, ±40KM Hector – Shongweni 400kV powerline and associated infrastructure. The proposed project is listed under Government Notice R984 (Listing Notice 2) Activity 9, therefore, the EIA process will be followed.

LOCATION

The proposed project will traverse various farms within the jurisdiction of EThekweni Metropolitan Municipality, Wards 4 and 103 in the Kwazulu Natal Province, South Africa. The map below indicates the study area.

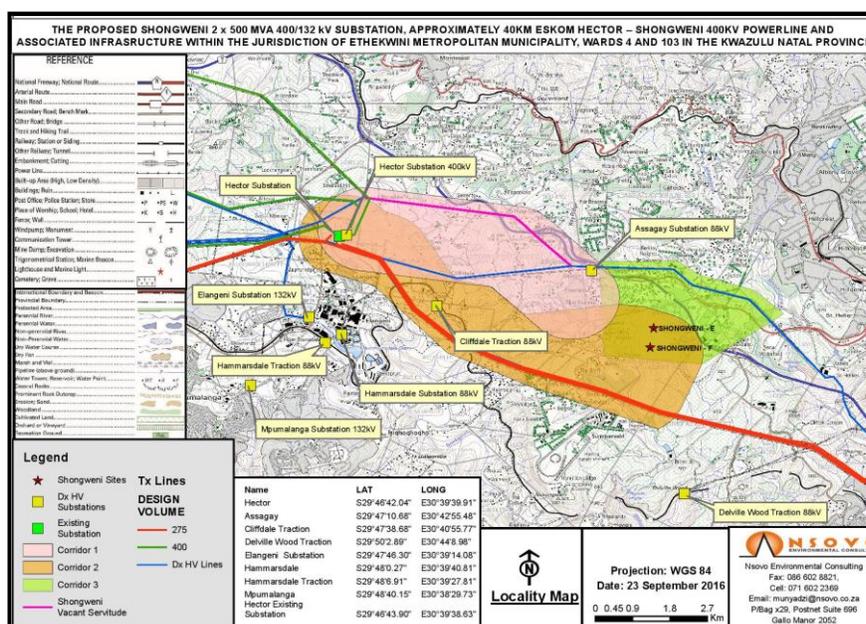

NAME OF APPLICANT
Eskom Holdings SOC Limited

CALL TO REGISTER AS AN INTERESTED AND AFFECTED PARTY

You are invited to register as an Interested and Affected Party or to submit your comments relating to this project through any of the contact details below, within the time frame (25 November 2016 – 23 January 2017) indicated above.

NSOVO ENVIRONMENTAL CONSULTING	
Contact Person:	Mrs Rejoice Aphane
Email:	ppp@nsovo.co.za or rejoice@nsovo.co.za
Tel:	011 041 3689
Fax:	086 602 8821
Postal address:	Postnet Suite 697, Private Bag X29, Gallo Manor, 2052

Please quote Reference F004-16 in all correspondence. This notice is prepared for and on behalf of Eskom Holdings SOC Limited.

